

USER MANUAL


CR Overload relay independent mounting kit

CMB09-25, CMB32, CMB40-80




Disconnect all power before installing, modifying or servicing equipment. Electric shock will result in death or serious injury. Only skilled & qualified personnel should carry out the following operations and must adhere to all appropriate national, regional and local standards applicable


①

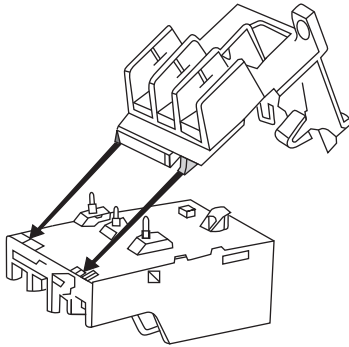

②




③

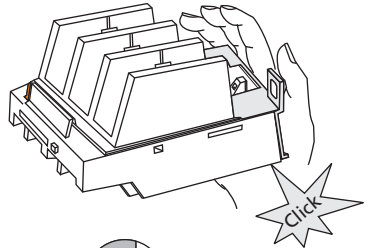


Independent mounting


CMB09-25

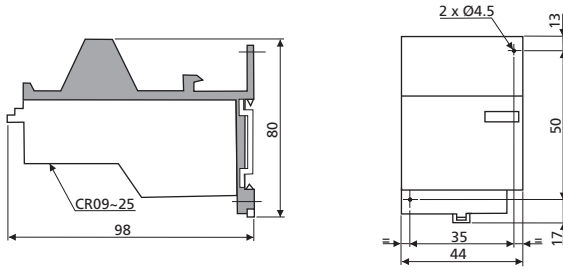

CMB32

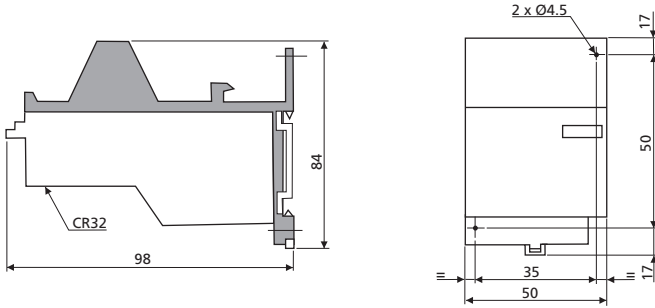

CMB40-80

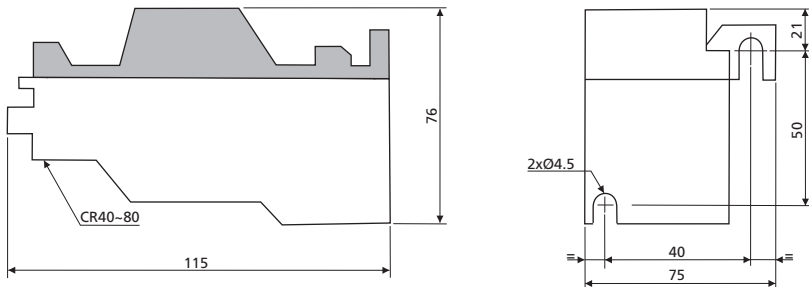

Crompton Controls Ltd.

Monckton Road, Wakefield, West Yorkshire WF2 7AL

Phone: +44 (0)1924 368251 Fax: +44 (0)1924 367274

E-mail: sales@cromptoncontrols.co.uk, www.cromptoncontrols.co.uk

XXXXX